


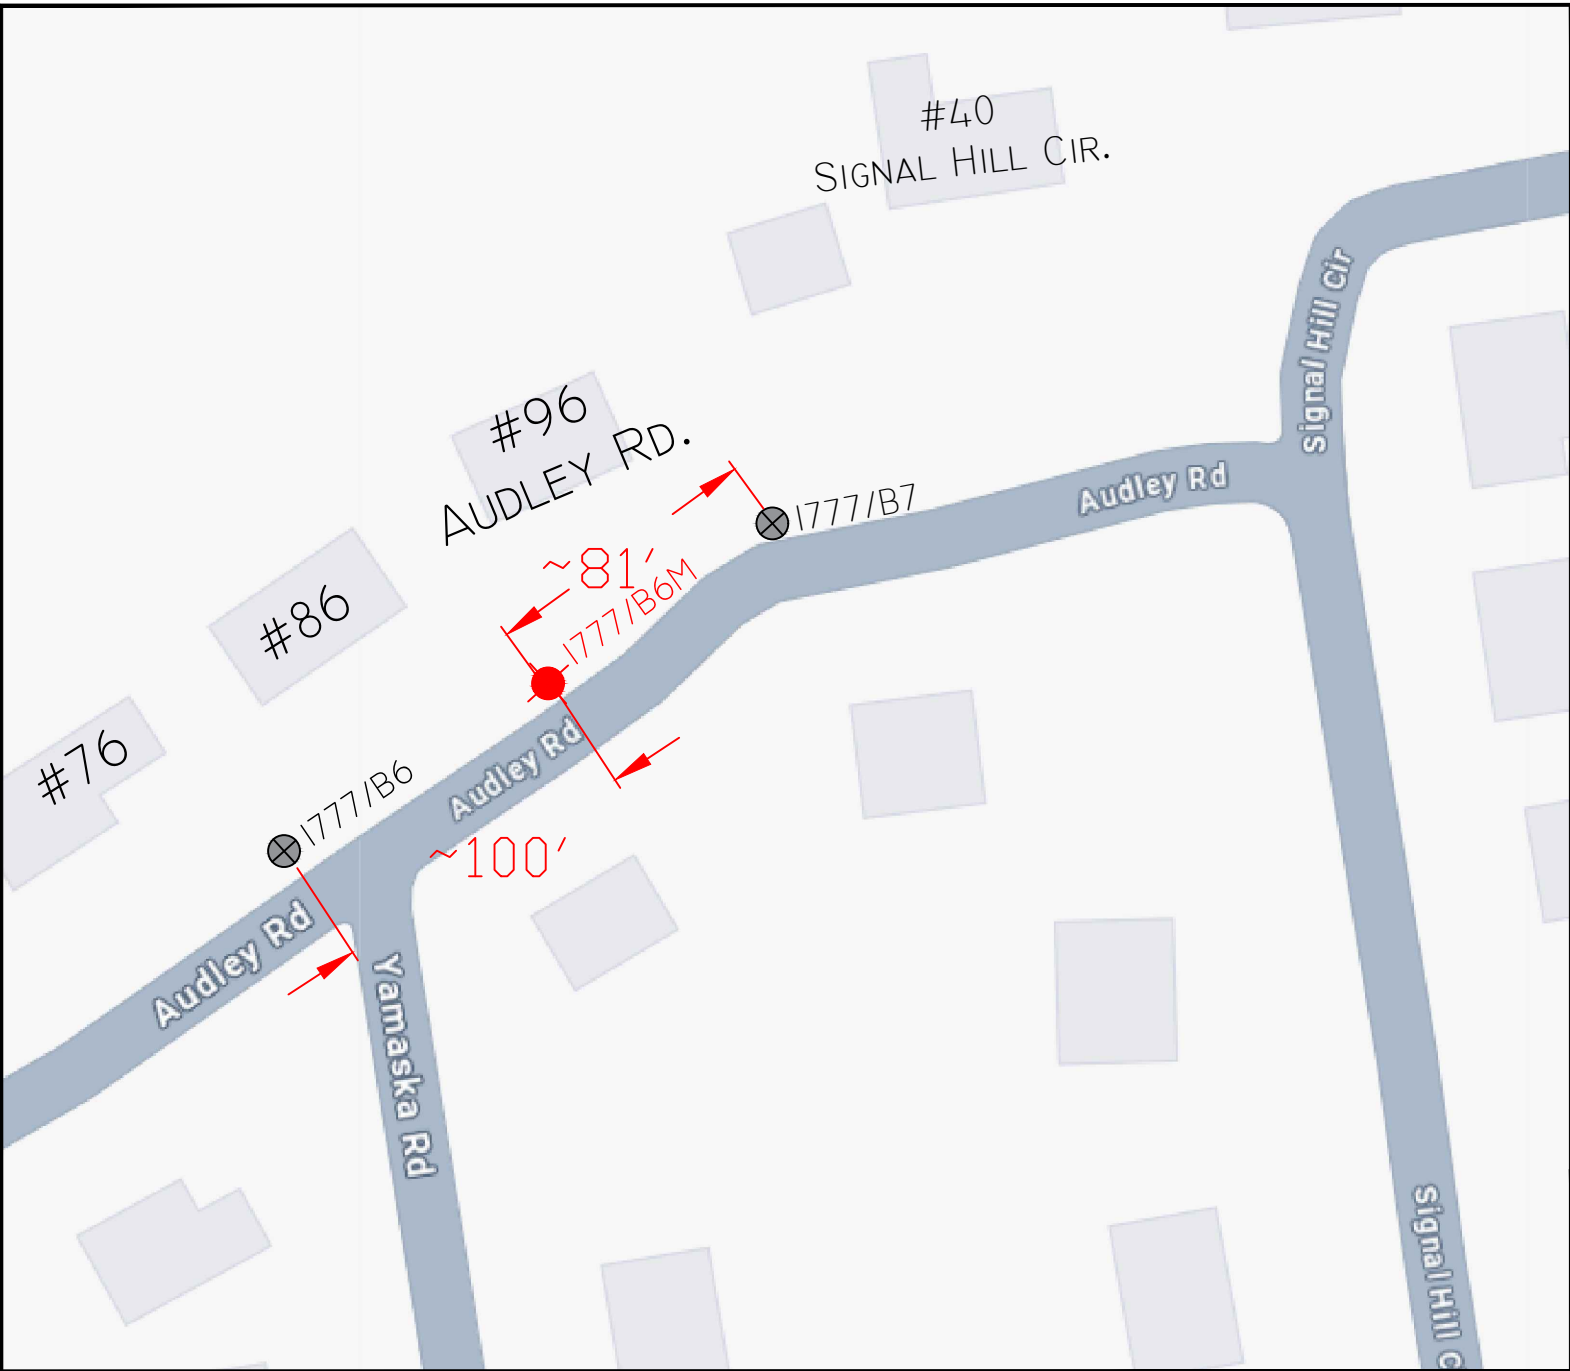

LEGEND

- PROPOSED JOINT POLE
- PROPOSED EVERSOURCE POLE
- EXISTING JOINT POLE
- EXISTING EVERSOURCE POLE
- EXISTING EVERSOURCE POLE TO BE JOINT
- EXISTING FOREIGN POLE TO BE JOINT
- PROPOSED PAD MOUNT TRANSFORMER
- EXISTING PAD MOUNT TRANSFORMER
- EXISTING MANHOLE
- UG EXISTING CONDUIT
- UG PROPOSED CONDUIT
- PROPOSED HANDHOLE
- EXISTING HANDHOLE
- ANCHOR
- PROPOSED SILO
- EXISTING SILO
- PROPOSED HEXHOLE

PROPRIETARY INFORMATION:

THE INFORMATION ON THIS MAP SHALL BE CONSIDERED PROPRIETARY TO EVERSOURCE AND THE USER (WHICH SHALL BE DEFINED AS ANY PERSON OR ENTITY WHO HAS RECEIVED THE MAP THROUGH SALE, PURCHASE, EXCHANGE, GIFT OR OTHERWISE) SHALL KEEP IT IN CONFIDENCE AND SHALL NOT FURNISH OR DISCLOSE IT TO ANY THIRD PARTY WITHOUT PRIOR WRITTEN PERMISSION OF EVERSOURCE UTILITIES.

EVERSOURCE
ENERGY

PURPOSE AND DESCRIPTION:

EVERSOURCE IS REQUESTING PERMISSION TO INSTALL (1) 40' CLASS I POLE. TO BE LOCATED APPROXIMATELY 100' NORTH EAST OF EXISTING POLE 1777/B6 AND APPROXIMATELY 80' SOUTH WEST OF EXISTING POLE 1777/B7 . THIS STRUCTURE WILL BE USED ACCOMMODATE REQUESTED SOLAR FROM #40 SIGNAL HILL CIR, SPRINGFIELD

PETITION PROPOSAL
AUDLEY RD.
SPRINGFIELD

DATE	CIRCUIT	VOLTAGE	WORK ORDER	WORK REQUEST
09/02/25	20A21	13.8kV	22600757	80402583
SCALE	NTS	DRAWN BY	A. BLAJDA	